




Series 3000B

Double Check Detector Assembly

Sizes: 2" (50mm)

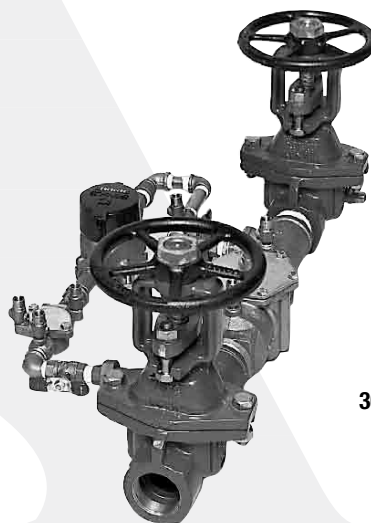

3000B

Features

- Bronze body
- Replaceable seats and discs
- Maximum flow at low pressure drop
- Compact for ease of installation
- Design simplicity for easy maintenance
- No special tools required for servicing
- Bronze body ball valve test cocks
- Modular spring loaded checks
- Furnished with bronze 5/8" x 3/4" (16 x 19mm) meter

Series 3000B Double Check Detector Assembly is designed exclusively for use in accordance with water utility authority containment requirements. It is mandatory to prevent the reverse flow of fire protection system substances, i.e., glycerin wetting agents, stagnant water and water of non-potable quality from being pumped or siphoned into the potable water line. The Series 3000B is ideal for use on non-health hazard fire protection systems to detect leaks or unauthorized water usage.

Modular check design concept facilitates maintenance and assembly access. All sizes are standardly equipped with resilient seated OSY shutoff valves and 5/8" x 3/4" (16 x 19mm) meter.

Specifications

A Double Check Detector Assembly shall be installed on fire protection systems when connected to a potable water supply. Degree of hazard present is determined by the local authority having jurisdiction. The backflow preventer shall be a complete assembly including UL listed resilient seated OSY shutoff valves and four test cocks. The test cocks located on the backflow preventer shall be mounted at the top of the valve to reduce clearance problems and to assist in the evacuation of air from the assembly. The assembly shall consist of two independently operating modular poppet-type check valves. The check valves shall utilize captured springs and shall have replaceable seats. The checks shall be double-guided, both along the outside edge of the check module and through the center stem assembly. The seats shall be replaceable without the use of special tools. Seat retention shall be done by the use of an interlocking bayonet-style cage and the use of threaded seats or seat screws is prohibited. Access to the internal check assemblies shall be via a single top entry cover. The cover shall be securely held in place by stainless steel bolts. Where applicable the unit shall be FM approved with FM approved OSY resilient seated shutoff valves. The assembly shall include an auxiliary bypass line consisting of an approved backflow preventer and water meter.

The assembly shall be listed or approved under the requirements of ASSE Std. 1048, AWWA Std. C510-92 and CSA B64.5. Approved by the Foundation for Cross-Connection Control and Hydraulic Research at the University of Southern California. The assembly shall be an Ames Company Series 3000B.

Job Name _____ Contractor _____

Job Location _____ Approval _____

Engineer _____ Contractor's P.O. No. _____

Approval _____ Representative _____

Ames product specifications in U.S. customary units and metric are approximate and are provided for reference only. For precise measurements, please contact Ames Technical Service. Ames reserves the right to change or modify product design, construction, specifications, or materials without prior notice and without incurring any obligation to make such changes and modifications on Ames products previously or subsequently sold.

Available Models

Suffix:


- LM - less meter
- CFM - cubic feet per minute meter
- GPM - gallons per minute meter
- OSY - UL/FM outside stem and yoke resilient seated gate valves
- LG - less shutoff valves

Materials

- Bronze body
- Durable tight seating silicone discs
- Stainless steel springs
- 5/8" x 3/4" (16 x 19mm) bronze bypass meter

Capacities

*UL Rated

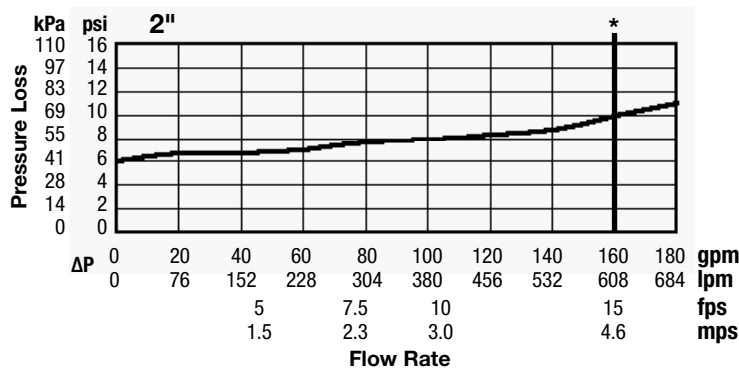


Pressure — Temperature

Suitable for supply pressure up to 175psi (12.06 bar)
Water temperature at 110°F (43°C) continuous.


Standards

AWWA Standard C510-92
CSA B64.5
IAPMO PS 31

Approvals



Dimensions – Weights

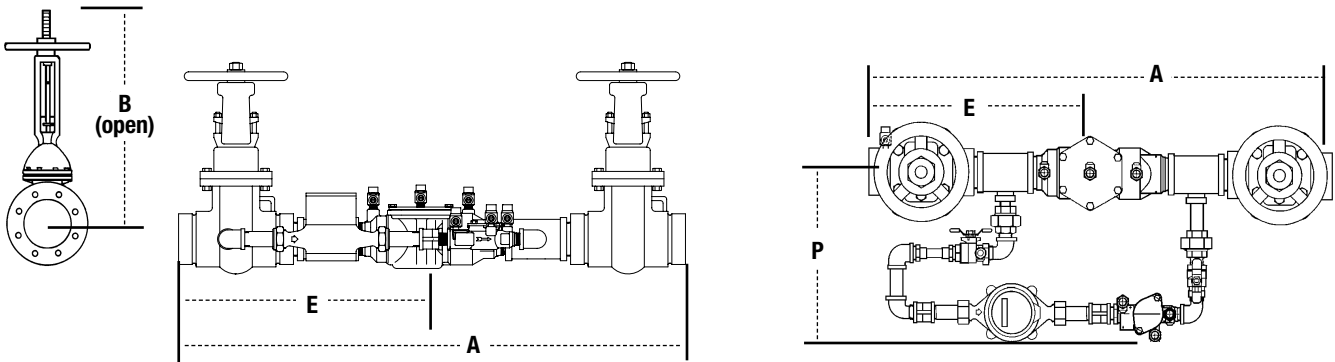

MODEL	SIZE (DN)		DIMENSIONS								WEIGHT	
	in.	mm	A		B		E		P		lbs.	kgs.
3000B	2	50	35 1/8	892	13 1/2	343	16 3/4	426	12 1/4	311	97	44



IMPORTANT: Inquire with governing authorities for local installation requirements.

www.amesfirewater.com



A Watts Water Technologies Company

USA: **Backflow-** Sacramento, CA • Tel: (916) 928-0123 • Fax: (916) 928-9333
Control Valves- Houston, TX • Tel: (713) 943-0688 • Fax: (713) 944-9445
Canada: Burlington, ON • Tel: (905) 332-4090 • Fax: (905) 332-7068

ES-A-3000B 0513

© 2011 Ames Fire & Waterworks